

CHECK  
YES or NO

**WATER FOUNTAINS**

- 1. Is there an accessible water fountain?
- 2. Is the accessible fountain mounted with the spout no higher than 36 inches above the floor?
- 3. Is there a cup dispenser available next to the water fountain?
- 4. If water fountains are mounted in an alcove, is the alcove at least 32 inches wide?
- 5. Can water fountain controls be operated without complicated hand movements and with no more than 5 pounds of pressure?
- 6. If a wall-mounted drinking fountain has a leading edge between 27 and 80 inches from the floor, does it project less than 4 inches into the pathway?
- 7. Do you periodically check the water source for contaminants?

**WORSHIP ACCESS** (See Figures 8 and 13 through 16)

- 1. Is there an accessible entrance into the worship area?
- 2. Are all aisles, including side aisles, at least 36 inches wide?
- 3. Are an appropriate number of wheelchair-accessible viewing positions provided in the worship seating space (nave pew space)?

Capacity of seating in assembly area	Required number of wheelchair locations
4 to 25	1
26 to 50	2
51 to 300	4
301 to 500	6
over 500	6 plus 1 additional space for each 100 beyond 500


- 4. Are wheelchair viewing positions dispersed throughout the nave seating area?
- 5. Is the floor level flat under wheelchair viewing positions?

---

CHECK  
YES or NO

---

6. Does the wheelchair viewing position have the same floor finish as the aisle?
7. If you use chairs rather than pews, have a few of the rows been shortened to accommodate wheelchairs?
8. Do all or at least some seats have cushioned seats and backs for those with back problems and arthritis to make sitting for long periods of time less painful? (*Above ADA requirements*)
9. Are all floor finishes uniform (with no carpet runners or changes in floor level greater than ½ inch)?
10. Is there a designated fragrance-free area for use by persons who are chemically sensitive?
11. Are the fragrance-free pews in a well-ventilated area of the sanctuary?
12. Are there facilities in the fragrance-free area for those who are mobility-, hearing-, or sight-impaired as well as chemically sensitive?
13. If there are steps into the chancel area, is a handrail provided for persons with mobility difficulties?
14. Is a ramp provided to make the chancel area of your church accessible to people in wheelchairs?
15. Is communion served in such a way that it is accessible to all persons?
16. If communion is served to people kneeling at the rail, is there a written and oral announcement that persons are welcome to come and stand or kneel as they partake of the elements, or that someone will serve them in their seats if that is desired?
17. If there is more than one weekly worship service, is one service a week advertised as being fragrance-free?
18. Does the church hold occasional fragrance- and candle-free services in uncarpeted areas with windows that open?
19. Have silk flowers or organic flower arrangements been considered as an alternative to flowers with pesticides?

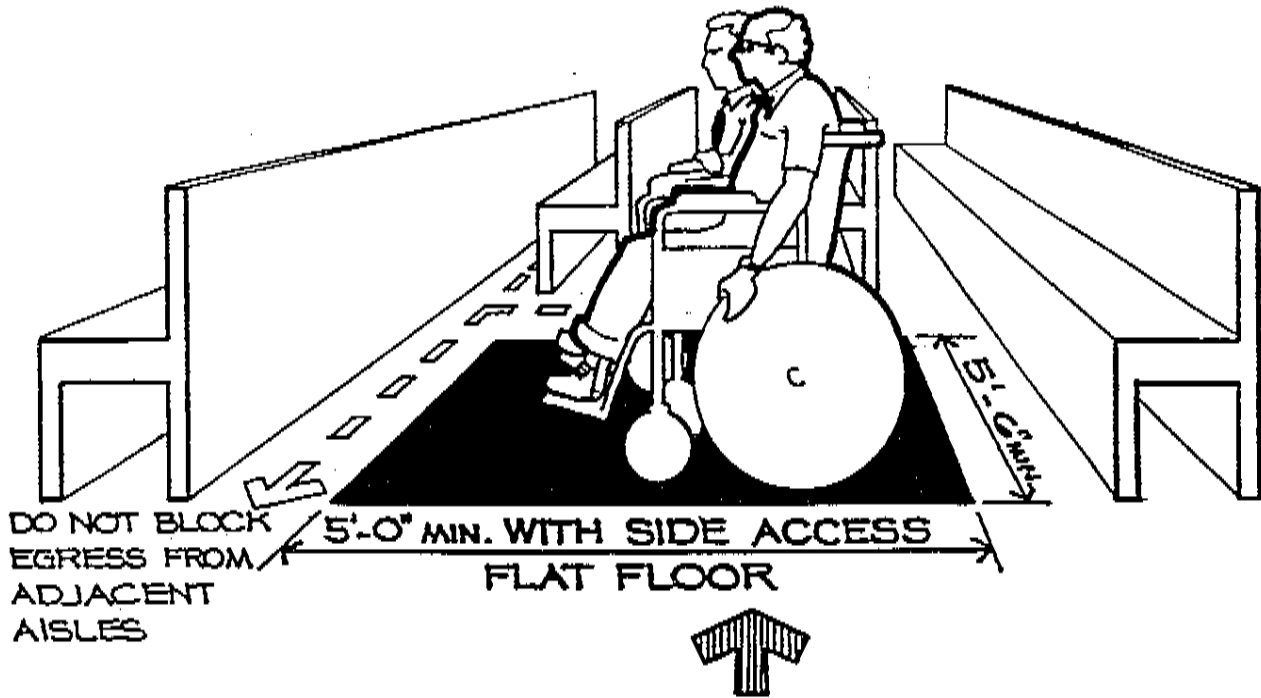

WHEELCHAIR VIEWING POSITIONS ARE NOT PERMITTED IN AISLES AND MUST BE LOCATED IN THE AREA OCCUPIED BY FIXED SEATS (PEWS)

EACH VIEWING POSITION SHALL ACCOMMODATE TWO WHEELCHAIRS

DISPERSE VIEWING POSITIONS THROUGHOUT THE NAVE SEATING AREA TO ALLOW PERSONS IN WHEELCHAIRS TO BE SEATED WITH THEIR FAMILY IN A NUMBER OF LOCATIONS.

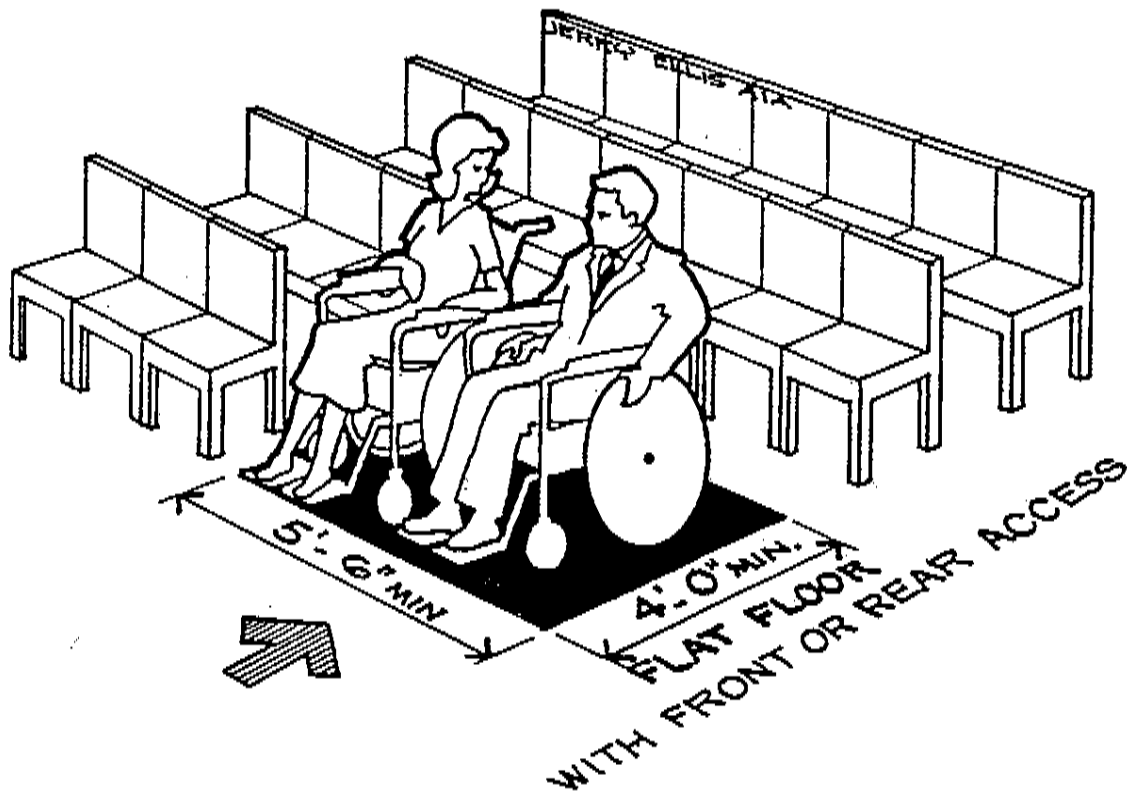


FIGURE 44